



RATINGS AND CAPACITIES			
Input - Low fire:	700,000	BTU/HR	
Input - High Fire:	3,500,000	BTU/HR	
Output - High Fire:	3,395,000	BTU/HR	
Boiler Horsepower:	101	BHP	
Thermal Efficiency:	97		
Combustion Efficiency:	97		
Heating Surface:	403	Sq.Ft.	
Water Vol. (gal):	47	Gallons	
Fuel:	Natural Gas or LP		
Firing Rate:	Full Modulation		
Burner Turndown:	5:1		
Low NOx Emissions:	<10 ppm		
Inlet Gas Pressure (NG):	4" (Min.) / 14" (Max.)		
Inlet Gas Pressure (LP):	8" (Min.) / 14" (Max.)		
Approx. Shipping Weight (lb):	2,485	lbs.	

FLOWS AND PRESSURE DROPS			
Flow (GPM)	Head Loss (ft)		
339	14.4		
226	7.6		
170	5.2		
	Flow (GPM) 339 226		

Electrical Requirements: (Appliance Only)					
Model	Voltage	Phase	Hz	Max. Amp Draw	
2000-2500	120	1	60	13.5	
	208			8.2	
	240			7.7	
	208	3	60	11	
	240			9.9	
	480			6.4	
3000	208	1	60	14.1	
	240	'		12.6	
	208	3	60	9.9	
	480			6.4	
3500-4000	208	3		11	
	240		3	60	9.9
	480			6.4	

ASME Section IV (Max 160 PSIG / 210°F)

Setpoint range is 60-185°F

Adjustable, manual reset high limit setting of ≤ 200°F.

ASME H stamp MAWT is 210°F for the vessel. (For max setpoint, see Setpoint range.)

ETL Certified to ANSI Z21.13 / CSA 4.9

ETL Certified to UL 795 / CSA 3.1



DIMENSIONS / CONNECTIONS			
Height:	55	(Note 1)	
Width:	46	(Note 2)	
Length:	97-1/8	(Note 3)	
Water Outlet Pipe (FNPT):	4		
Water Inlet Pipe (MNPT):	4		
Vent Connection:	12		
Air Intake Connection:	12		
Condensate Drain (PVC):	1		
Drain Line Connection:	3/4		
Gas Inlet Connection (FPT):	2		

NOTES:	
1. Height dimension is from floor to top of jacket.	
2. Length is from jacket front to jacket rear.	
3. Dimensions shown are for reference only	
4. Refer to manual for gas supply piping charts	



### STANDARD EQUIPMENT

#### PRESSURE VESSEL DESIGN

Stainless Steel Heat Exchanger

ASME Section IV Certified, "H" Stamp

MAWP 160 PSIG & Max Temp 210°F

Setpoint range is 60-185°F

Adjustable, manual reset high limit setting of ≤ 200°F.

ASME H stamp MAWT is 210°F for the vessel. (For max setpoint, see Setpoint range.)

Ten Year Limited Pressure Vessel Warranty

#### **COMBUSTION DESIGN**

Stainless Steel Pre-Mix Burner Zero governor gas valve

Low NOx Emissions (<10 ppm) Variable Speed Combustion Blower

Full Modulation, 5:1 Turndown

Air Proving Switch

Blocked Vent Switch

Blocked Vent Switch

Natural Gas, Propane or Dual Fuel (Gas/Gas)

4" wc (8" wc Propane) to 14" wc inlet gas pressure

Manual fuel changeover switch (Dual Fuel Only)

4" wc (8" wc Propane) to 14" wc inlet gas pressure

High/Low gas pressure switches, manual reset

Direct Spark Ignition System with UV Scanner

#### **VENTING**

Category II or IV Venting

Indivdual or Common (Engineered) Vent System

Vertical or Horizontal

CPVC, PP or SS Venting \*Materials Acceptable

Combustion Air Intake - Sealed or Room

#### **BOILER EQUIPMENT**

Concert ™ Control (24 Vac) Water Flow Switch
High Limit Temp Control, Manual Reset Condensate trap

Low water cutoff, manual reset Blocked Condensate Switch

Supply & Return Water Temperature

Pressure & Temperature Gauge

Sensor

Flue Gas Temperature Sensor

ASME Relief Valve: (Available: 30, 50, 60, 75, 100, 125 or 150 psig)

#### **ELECTRICAL DESIGN**

#### Models 2000-2500:

- 120-208-230VAC/60HZ/1PH - High Voltage

(2000 to 2500 - Optional 208-230-460VAC/60HZ/3PH)

#### Models 3000:

- 208-230-240VAC/60HZ/1PH High Voltage
- 208-230-240-460VAC/60HZ/3PH High Voltage

#### Models 3500-4000:

- 208-230-240-460VAC/60HZ/3PH High Voltage
- PCB (Printed Circuit Board) Fused Connections

24VAC/5VDC - Low Voltage PCB

- EMS Communications
- (Dual RJ45 Jacks for Peer-To-Peer or ModBus)
- Boiler Options (Sensors)
- Pumps (Boiler, DHW, System) & Auxiliary Devices

<sup>\*</sup> Flue system material shall be capable of continuous operation at 210°F or higher and shall be certified to UL 1738 – venting system for gas-burning appliances cat II, III and IV.



			OPTIONAL EQUIPMENT		
	Hydronic Kit (Boiler Ci	rculation Pump, Pump Flange Kit and	d Condensate Neutralizer)		
	External High Limit Ter	nperature Control, Manual Reset			
	Condensate Neutraliz	er			
	Supply Header Tempe	erature Sensor:	Direct Immersion	■ Well Immersion (with \	Well)
	Outdoor Air Temperat	rure Sensor (Wired)			
	EMS Signal Converter Kit (Converts Energy or Building Management System 0-10v signal to 4-20mA)				
	Motorized Isolation Vo	alves			
	Alarm Buzzer with Silencing Switch				
	Gas Valve Proving Switch				
	Vent Adapter - CPVC				
	Universal Communications Gateway (BACnet, Metasys, Modbus or Lonworks)				
	Stackable Rack				
	Conductor Sequencir	ng Panel	Optional Isolation Rel	ay Board	
	The Conductor manages multiple condensing & non-condensing, small & large heat output, new and/or existing boilers (full modulation or on-off), and steam or hot water applications. It helps improve system efficiency by selecting and modulating the right boiler to match operating conditions. The Conductor offers a single point boiler plant Energy Management System (EMS) interface including Modbus TCP/IP, Modbus RTU RS485, BACnet/IP and BACnet MSTP standard. If Lonworks needed, add for the separate Lonworks gateway.				
			EXTENDED WARRANTY		
	☐ 3-Year Parts	5-Year Parts	☐ 10-Year Parts	5-Year Parts/Labor	☐ 10-Year Parts/Labor



### **CONCERT CONTROL FEATURES**



#### Dashboard - Color Touchscreen Display, 4"

Intuitive Icon Navigation

"Quick" Setup Menus

\*Real Time BTU/H Display

#### Two (2) Temperature Demand Inputs

Outdoor Air Reset Curve for Each Input

Time of Day Setback Capability

(Enviracom Thermastat must be installed)

#### Three (3) Pump Control

Boiler Pump With On/Off or Variable Speed Control

Domestic Hot Water (DHW) Pump

System Pump

Alternative Control to Combustion

Air Damper or Standby Loss Damper

Pump Overun for Heat Dissipation

Pump Exercise

Pump Rotor Seizing Protection

#### Peer-to-Peer Boiler Communications

Multiple Size Boiler Sequencing Up to 8 Units

\*Two (2) Boiler Start/Stop Trigger

Lead Boiler Automatic Rotation

#### Energy Management System (EMS) Interface

\*Firing Rate and Water Temperature Based

Algorithms for Multiple Boilers; loss of EMS

signal defaults to local boiler settings

420mAdc Input/Output (010Vdc Optional Converter)

ModBus Input/Output (BACnet or LonWorks

Optional Gateway)

Simultaneous Interface with Peer-to-Peer

#### **USB Data Port Transfer**

Upload Settings Between Boilers

Download Parameters for Troubleshooting

Import Data into .CRV Formatted Files for Performance Analysis

Andrysis

\* Unique to Concert



#### **Energy Efficiency Enhancer**

AntiCycling Technology

Multipler boiler base load common rate

Outdoor Air Temperature Reset Curve

Warm Weather Shutdown

Boost Temperature & Time

Ramp Delay

OverTemperature Safeguarding

#### Self-Guidina Diagnostics

**Identifies Fault** 

Describes Possible Problems

**Provides Corrective Actions** 

Time/Date Stamp on Alarms and Lockouts

#### **Unmatched Archives**

Historical Trends Collects Up to 4 months Data

Event History Up to 3000 Alarms, Lockouts and Cycle & Run Times

Alarm Limit String Faults, Holds, Lockouts and Others

Cycle & Run Time Boilers & Pumps

Resettable (Lockouts/Alarms/Cycles & Run Time)

#### **Domestic Hot Water Priority**

DHW Tank Piped With Priority in the Boiler Loop

DHW Tank Piped as a Zone in the System With

the Pumps Controlled by the Concert Control

**DHW Modulation Limiting** 

Status Screens

Sensor Monitoring and Control

#### Other Features

Factory Default Settings

Three Level Password Security


Frost Protection

Contractor Contacts (Up to 3)

Low Water Flow Safety Control & Identification Proportion Integral Derivative (PID) Parameters for Central Heat, DHW, Sequencer and Fan Boiler Connect Compatible \*

\* Models 2000-4000 require Service Tool PCB14 Kit (PN#113430-01) and one (1) Boiler Connect Bluetooth Adapter Kit (PN#113329-01) per install or cascade.



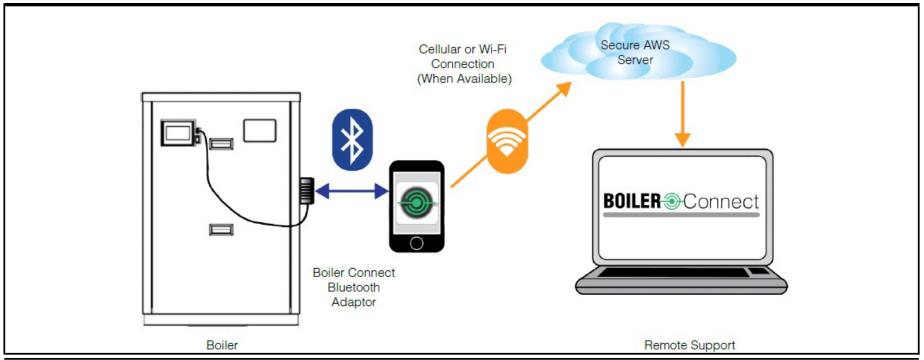

# **BOILER** Connect

### **BOILER CONNECT FEATURES**

Bluetooth adapter connects to the Boiler Connect App

English or Spanish language

Start-up, Troubleshooting Tips and Service Wizards

Data logs, Service and Status Reports sent to the cloud

Live Data Sharing (Cellular Service Required) with Technical Service Representative