


Submittal Data Sheet



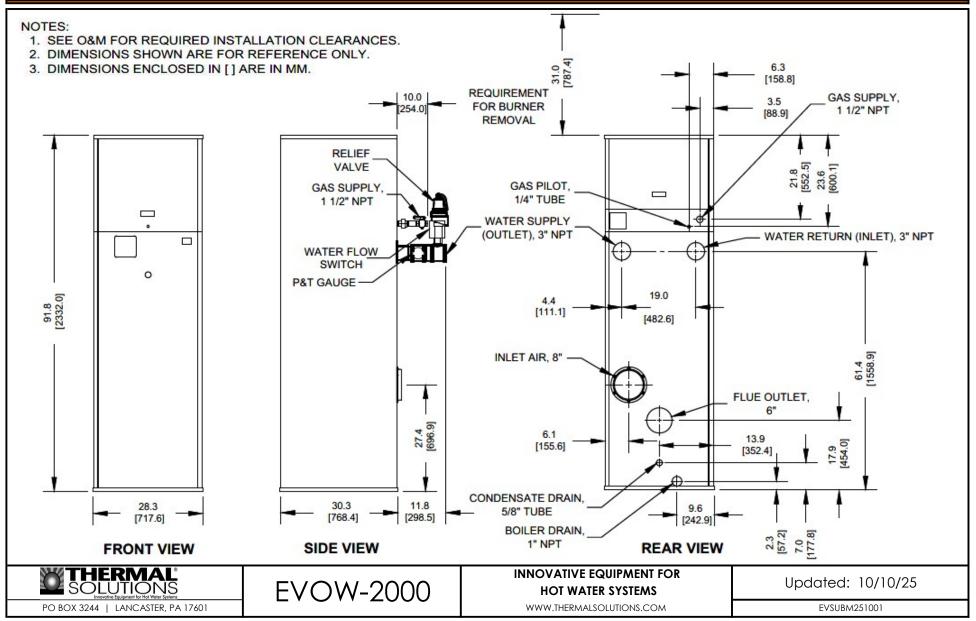

Submittal Data Sheet

RATINGS AND CAPACITIES			
Input (MBH):	2,000,000	BTU/HR	
Output (MBH):	1,760,000	BTU/HR	
Boiler Horsepower:	52.6	BTU/HR	
Thermal Efficiency:	88.0%	BHP	
Heating Surface:	352 Sq.Ft.		
Water Content:	18.5 Gallons		
Fuel:	Natural Gas or LP Gas		
Firing Rate: Reliable Modulation			
Purpor Turndown:			

Burner Turndown: 3:1

Low NOx Emissions: <10 ppm

Inlet Gas Pressure (NG): See Chart at right See Chart at right Inlet Gas Pressure (LP):

Shipping Weight, Approximate: ASME Section IV (Max 160 PSIG / 210°F)

Setpoint range is 145-190°F

Adjustable, manual reset high limit setting of ≤ 200°F.

ASME HLW stamp MAWT is 210°F for the vessel. (For max setpoint, see Setpoint range.)

1,461

UL Certified to ANSI Z21.10.3/CSA 4.3



lbs

DIMENSIONS / CONNECTIONS			
Height:	91 3/4"	(Note 1)	
Width:	28 3/8"	(Note 2)	
Length:	30 3/8"	(Note 3)	
Supply Connection:	3"		
Return Connection:	3"		
Vent / Air Intake Connections:	6" Vent	8" Intake	
Condensate / Appliance Drain Connection:	5/8" Condensate Tube	1" NPT Drain	
Gas Connection:	1 1/2"		

NOTES:		
1. Height dimension is from floor to top of jacket.		
2. Length is from jacket front to jacket rear.		
3. Dimensions shown are for reference only		

FLOWS AND PRESSURE DROPS		
Delta T	Flow (GPM)	△P (Ft. Hd)
20°F△T	170 (Max)	13.27
40°F△T	85 (Min)	3.32

Electrical Supply Options		
	120v/60hz/1ph (Standard)	7.5 amps
	208v/60hz/1ph	6.6 amps
	230v/60hz/1ph	6.4 amps
	208v/60hz/3ph	6.0 amps
	230v/60hz/3ph	6.0 amps
	460v/60hz/3ph	3.0 amps

Blower Motor	(hp)
1-1/2	

Relief Valve Options		
	125 psi (STANDARD)	
	150 psi (OPTIONAL)	

Inlet Gas Pressure			
SIZE	Nat. Gas Min. ("w.c.)	LP Min. ("w.c.)	Max
500	5.0" w.c.		14.0" w.c.
750	7.0" w.c.*	8.0" w.c.	
1000	7.0" w.c.*	0.0 w.c.	
1500	7.0" w.c.*		
2000	9.0" w.c.*	9.0" w.c.	
2000s	7.0" w.c.		
2500	6.0" w.c.	8.0	
3000	6.0" w.c		

^{*} NOTE: Optional natural gas train with 4" w.c. minumum inlet gas pressure ONLY AVAILABLE on sizes 750, 1000, 1500 & 2000.

^{*} This data supercedes data found on Table 3 of I&O Manual, per PRODUCT UPDATE issued June 6, 2024.



Submittal Data Sheet

STANI	DARD EQUIPMENT		OPTIONAL EQUIPMENT
PRESSURE VESSEL DESIGN Copper Fin-tube construction	BOILER EQUIPMENT Siemens RWF55 operating control		Low gas pressure venturi, 4" wc (AVAILABLE ONLY on Models 750-2000) [FACTORY INSTALLED OPTION ONLY]
Bronze header design Gasketless heat exchanger	High limit w/ manual reset safety temperature control Water flow switch		Line Reactor Adds voltage / spike protection for the blower's VFD. (Highly recommended for areas with dirty voltage.)
ASME Section IV certified "H" stamp MAWP 160 PSI & max design temp 250°F 5-year heat exchanger warranty 20-year thermal shock warranty	Low water cut-off with manual reset safety controller Outlet temperature sensor Combustion air switch Pressure and temperature gauge		Honeywell 7800 Series display with ModBus Module Line Reactor Adds voltage / spike protection for the blower's VFD. (Highly recommended for areas with dirty voltage.) Outdoor Air Sensor
COMBUSTION DESIGN Maintenance-free ceramic burner Ultr-low NOx emissions (<10ppm) Whisper quet operation (<50 dBA)	Safety relief valve (Optional pressuress 30 - 150 PSI; See details above.) Single point electrical supply: (Available in: 1 and 3 phase options. See details above.) BURNER EQUIPMENT		Condensate neutralizer:
Easy to service, 99% efficient industrial air filter Industrial cast aluminum blower assembly VFD Driven Blower Reliable electric spark-to-pilot ignition 10-year burner warranty Honeywell UV-Scanner VENTING Sealed or room air combustion Direct vent (sidewall or vertical) (Cat IV) Conventional venting (Cat II) NOTE: This is NOT a Cat 1 Vent appliance.	UL/FM/CSD-1 gas train Reliable Turndown Natural or LP gas Pilot gas valve / Pilot gas regulator Siemens SKP-75 gas valve Low and high gas pressure switches with manual reset SIEMENS RWF55 OPERATING CONTROL FEATURES Adjustable set point Remote set point (0-10v or 4-20 mA) Outdoor air temperature reset	non-	Annual Maintenance Kit System Temperature Sensor ModBus RS485 communication for Siemens RWF55 and Honeywell Flame Safeguard Control (Boiler to BMS System) Universal comms. gtwy (BACnet MS/TP, BACnet/IP, N2, Modbus TCP) Local / remote switch Alarm bell with silencing switch Relays: General Alarm Boiler Status Conductor Sequencing Panel: Req. for multiple EVA applications without BMS. Contact your RSM with Questions.) Conductor Sequencing Panel manages multiple condensing & condensing, small & large heat output, new and/or existing rs (full modulation), and steam or hot water applications. It
be less than 32 °F (0 °C). Appliance must be	ion only in climates where the ambient temperature will not protected from standing water. Install on a level platform. rhang less than 3 feet from its top. The area under the all directly on carpeted flooring.	right single inclu	s improve system efficiency by selecting and modulating the boiler to match operating conditions. The Conductor offers a point boiler plant Energy Management System (EMS) interface ding Modbus TCP/IP, Modbus RTU RS485, BACnet/IP and BACnet standard. If Lonworks needed, add for the separate Lonworks way. Extended Warranty Options Available:
		<u> </u>	3-Year 5-Year 10 Year Parts Only Parts and Labor N/A